


- Notes:
- LIGHTNING MONOPOLE POSITION INDICATIVE ONLY & SUBJECT TO A LIGHTNING PROTECTION STUDY.
 - A BORED WELL WILL BE LOCATED WITHIN THE COMPOUND FOR A POTABLE WATER SUPPLY TO THE BUILDINGS. LOCATION SHOWN ON DRAWINGS INDICATIVE ONLY
 - OIL SEPARATOR TO BE CLASS 1 FULL RETENTION SYSTEM.

ASSOCIATED DRAWINGS:

- FOR CONTINUATION OF FOUL & SURFACE WATER DRAINAGE SEE DRAWING NO. QR-320201-P-000-066
- FOR BUILDINGS DETAILS SEE DRAWING NO. QR-320201-P-000-074
QR-320201-P-000-075
QR-320201-P-000-076
QR-320201-P-000-077
QR-320201-P-000-078

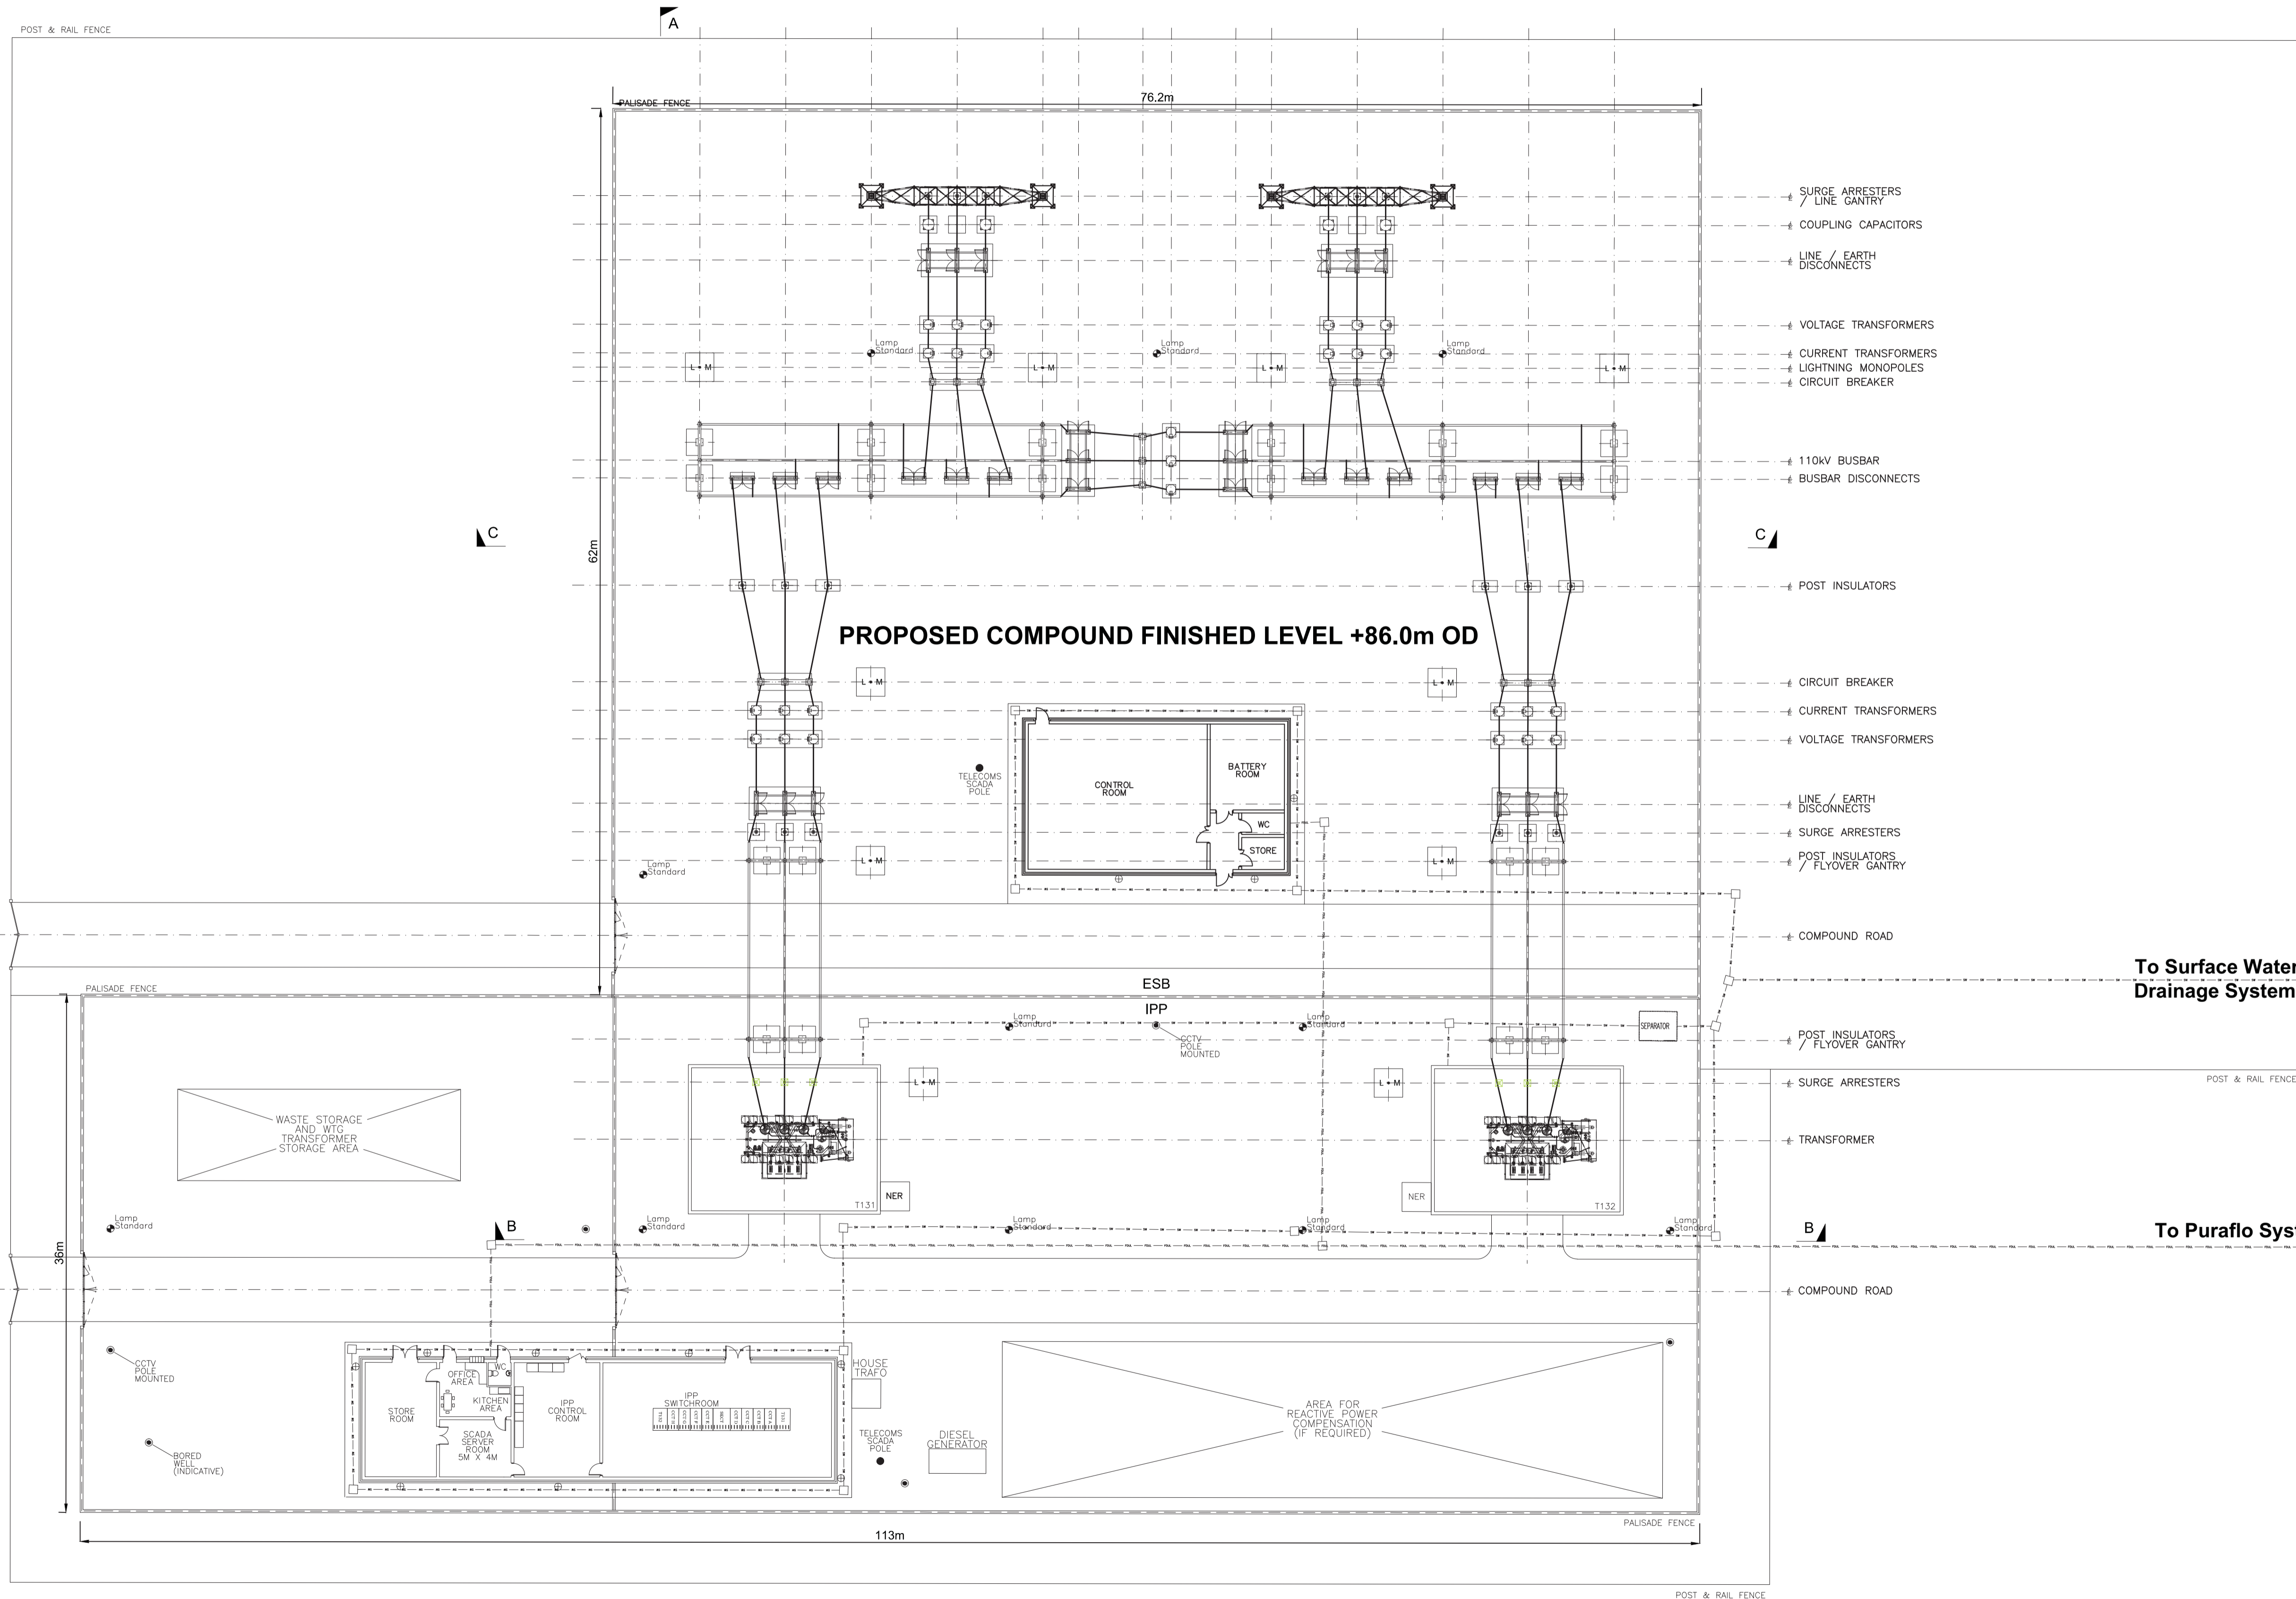

To Surface Water
Drainage System

To Puraflo System

0	15.04.13	ISSUED FOR PLANNING	PM	PK	JC
REV.	DATE	REVISION DESCRIPTION	DRN	VER	APP
PURPOSE OF ISSUE - PRELIMINARY UNLESS INDICATED					
TENDER	<input type="checkbox"/>	CLIENT APPROVAL	<input type="checkbox"/>	CONSTRUCTION	<input type="checkbox"/>
		AS-BUILT	<input type="checkbox"/>	REVISED	<input type="checkbox"/>
Client	OWENINNY POWER LTD.				
Project	WIND FARM PROJECT AT OWENINNY, BELLACORICK, CO. MAYO				
Contract					
Drawing Title	OWENINNY WINDFARM 110kV SUBSTATION 1 LAYOUT PLAN				
Production Unit	CIVIL, BUILDING & ENVIRONMENTAL GROUP				
<p>Oweninny Power Ltd</p> <p>Oweninny Power Ltd, Stephen Court, 18-21 St. Stephen's Green, Dublin 2, Ireland Tel: +353 (0)1 7038000 Fax: +353 (0) 1 7038088 Email: oweninnypower@esbi.ie Web: www.oweninnywindfarm.ie Registered Office: as above Registered in Ireland No. 503730</p>					
DRAWN	PM	VERIFIED	PK	APPROVED	JC
CLIENT REF	No. of SHEETS		SIZE	REV	SCALE
	1		A1	0	1:250
DRAWING NUMBER					
QR320201-P-000-043					