


- Notes:
- LIGHTNING MONOPOLE POSITION INDICATIVE ONLY & SUBJECT TO A LIGHTNING PROTECTION STUDY.
 - A BORED WELL WILL BE LOCATED WITHIN THE COMPOUND FOR A POTABLE WATER SUPPLY TO THE BUILDINGS. LOCATION SHOWN ON DRAWINGS INDICATIVE ONLY
 - OIL SEPARATOR TO BE CLASS 1 FULL RETENTION SYSTEM.

- ASSOCIATED DRAWINGS:
- FOR CONTINUATION OF FOUL & SURFACE WATER DRAINAGE SEE DRAWING NO. QR-320201-P-000-067
 - FOR BUILDINGS DETAILS SEE DRAWING NO. QR-320201-P-000-074
QR-320201-P-000-075
QR-320201-P-000-076
QR-320201-P-000-077
QR-320201-P-000-078

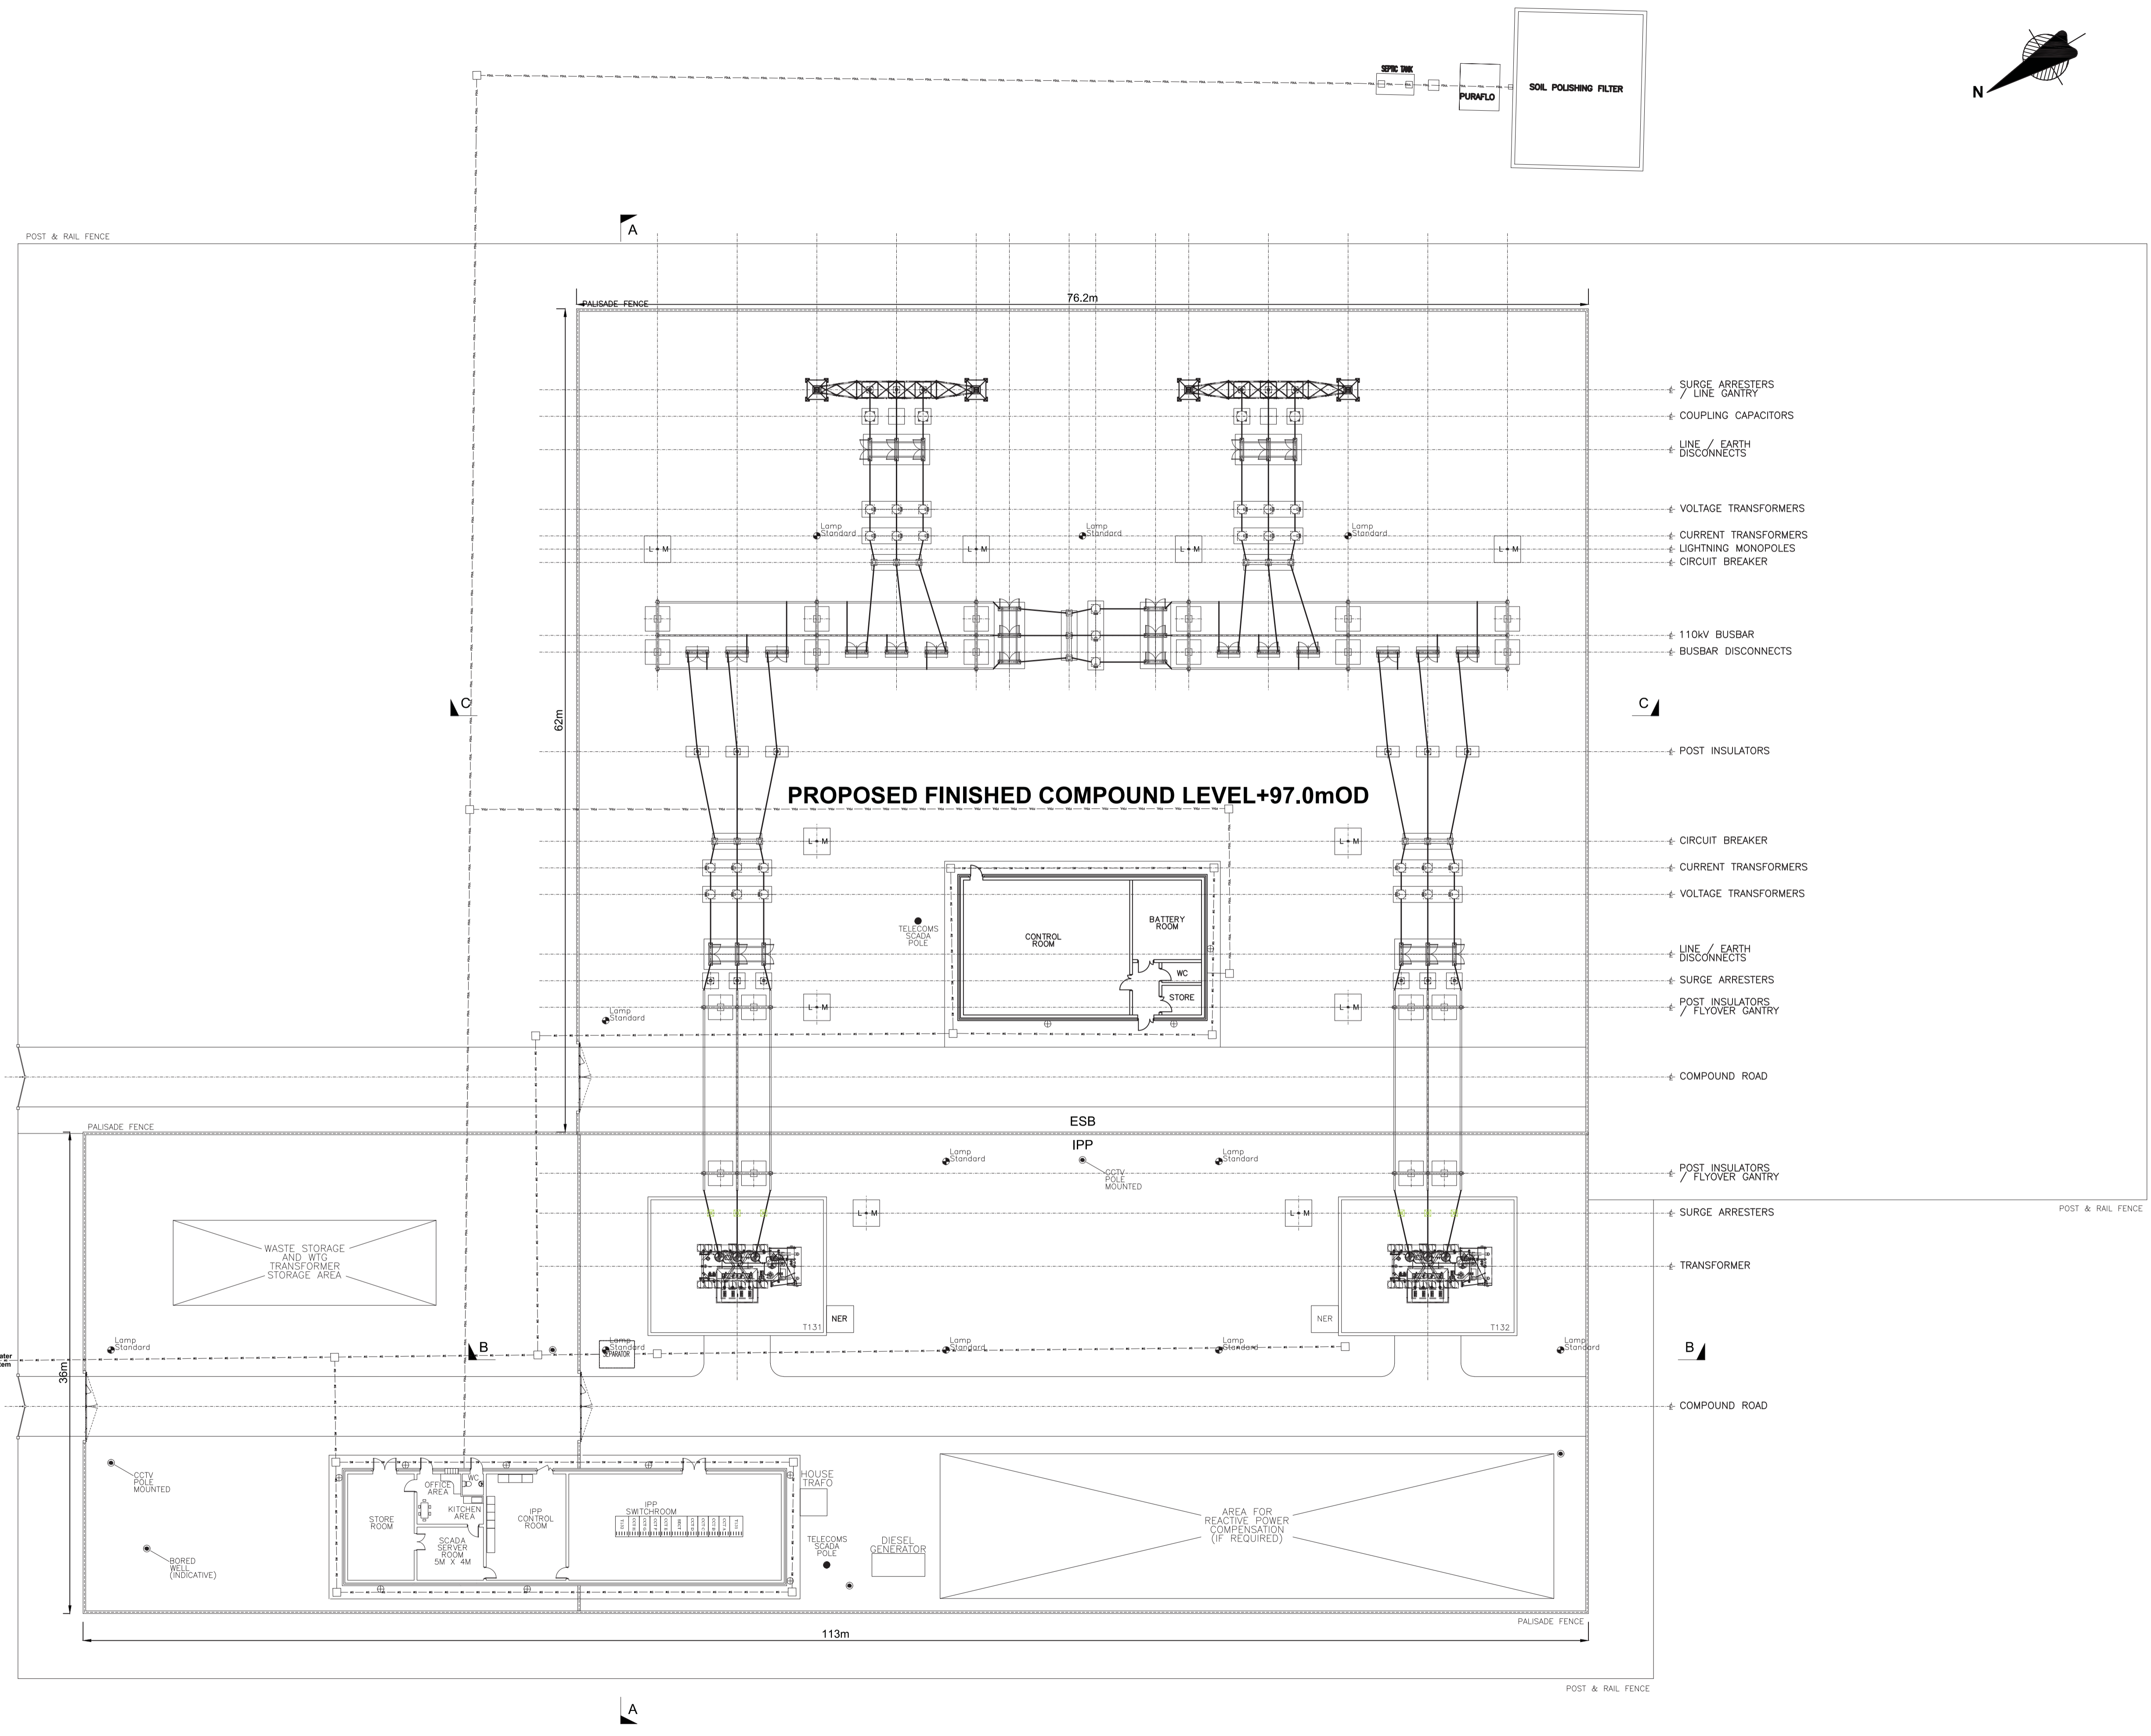

0	15.04.13	ISSUED FOR PLANNING	PM	PK	JC
REV.	DATE	REVISION DESCRIPTION	DRN	VER	APP
PURPOSE OF ISSUE - PRELIMINARY UNLESS INDICATED					
TENDER	<input type="checkbox"/>	CLIENT APPROVAL	<input type="checkbox"/>	CONSTRUCTION	<input type="checkbox"/>
		AS-BUILT	<input type="checkbox"/>	REVISED	<input type="checkbox"/>
Client					
OWENINNY POWER LTD.					
Project					
WIND FARM PROJECT AT OWENINNY, BELLACORICK, CO. MAYO					
Contract					
Drawing Title					
OWENINNY WINDFARM PROPOSED 110kV STATION LAYOUT OF SUBSTATION 2					
Production Unit					
CIVIL, BUILDING & ENVIRONMENTAL GROUP					
Oweninny Power Ltd					
Oweninny Power Ltd, Stephen Court, 18-21 St. Stephen's Green, Dublin 2, Ireland Tel: +353 (0)1 7038000 Fax: +353 (0) 1 7038088 Email: oweninnypower@esbi.ie Web: www.oweninnywindfarm.ie Registered Office: as above Registered in Ireland No. 503730					
DRAWN	VERIFIED	APPROVED	APPRO DATE		
PM	PK	JC	13.03.13		
CLIENT REF	No. of SHEETS	SIZE	REV	SCALE	
	1	A1	0	1:250	
DRAWING NUMBER					
QR320201-P-000-045					

COPYRIGHT © ESSI ENGINEERING & FACILITY MANAGEMENT LIMITED.
All rights reserved. No part of this work may be modified or reproduced or copied in any form or by any means, graphic, electronic or mechanical, including photocopying, recording, taping or information-and-retrieval system, or used for any purpose other than its designated purpose, without the written permission of ESSI Engineering & Facility Management Ltd.

While every effort has been made to ensure the accuracy of the information contained in the drawings, Oweninny Power Limited cannot be held responsible for errors or omissions.